



OTHER CONTROL OPTIONS ARE AVAILABLE:  
 pH PROBE AUTO CALIBRATION  
 pH PROBE AUTO CLEANING  
 DRUM LEVEL SWITCHES  
 TANK LEVEL SWITCHES

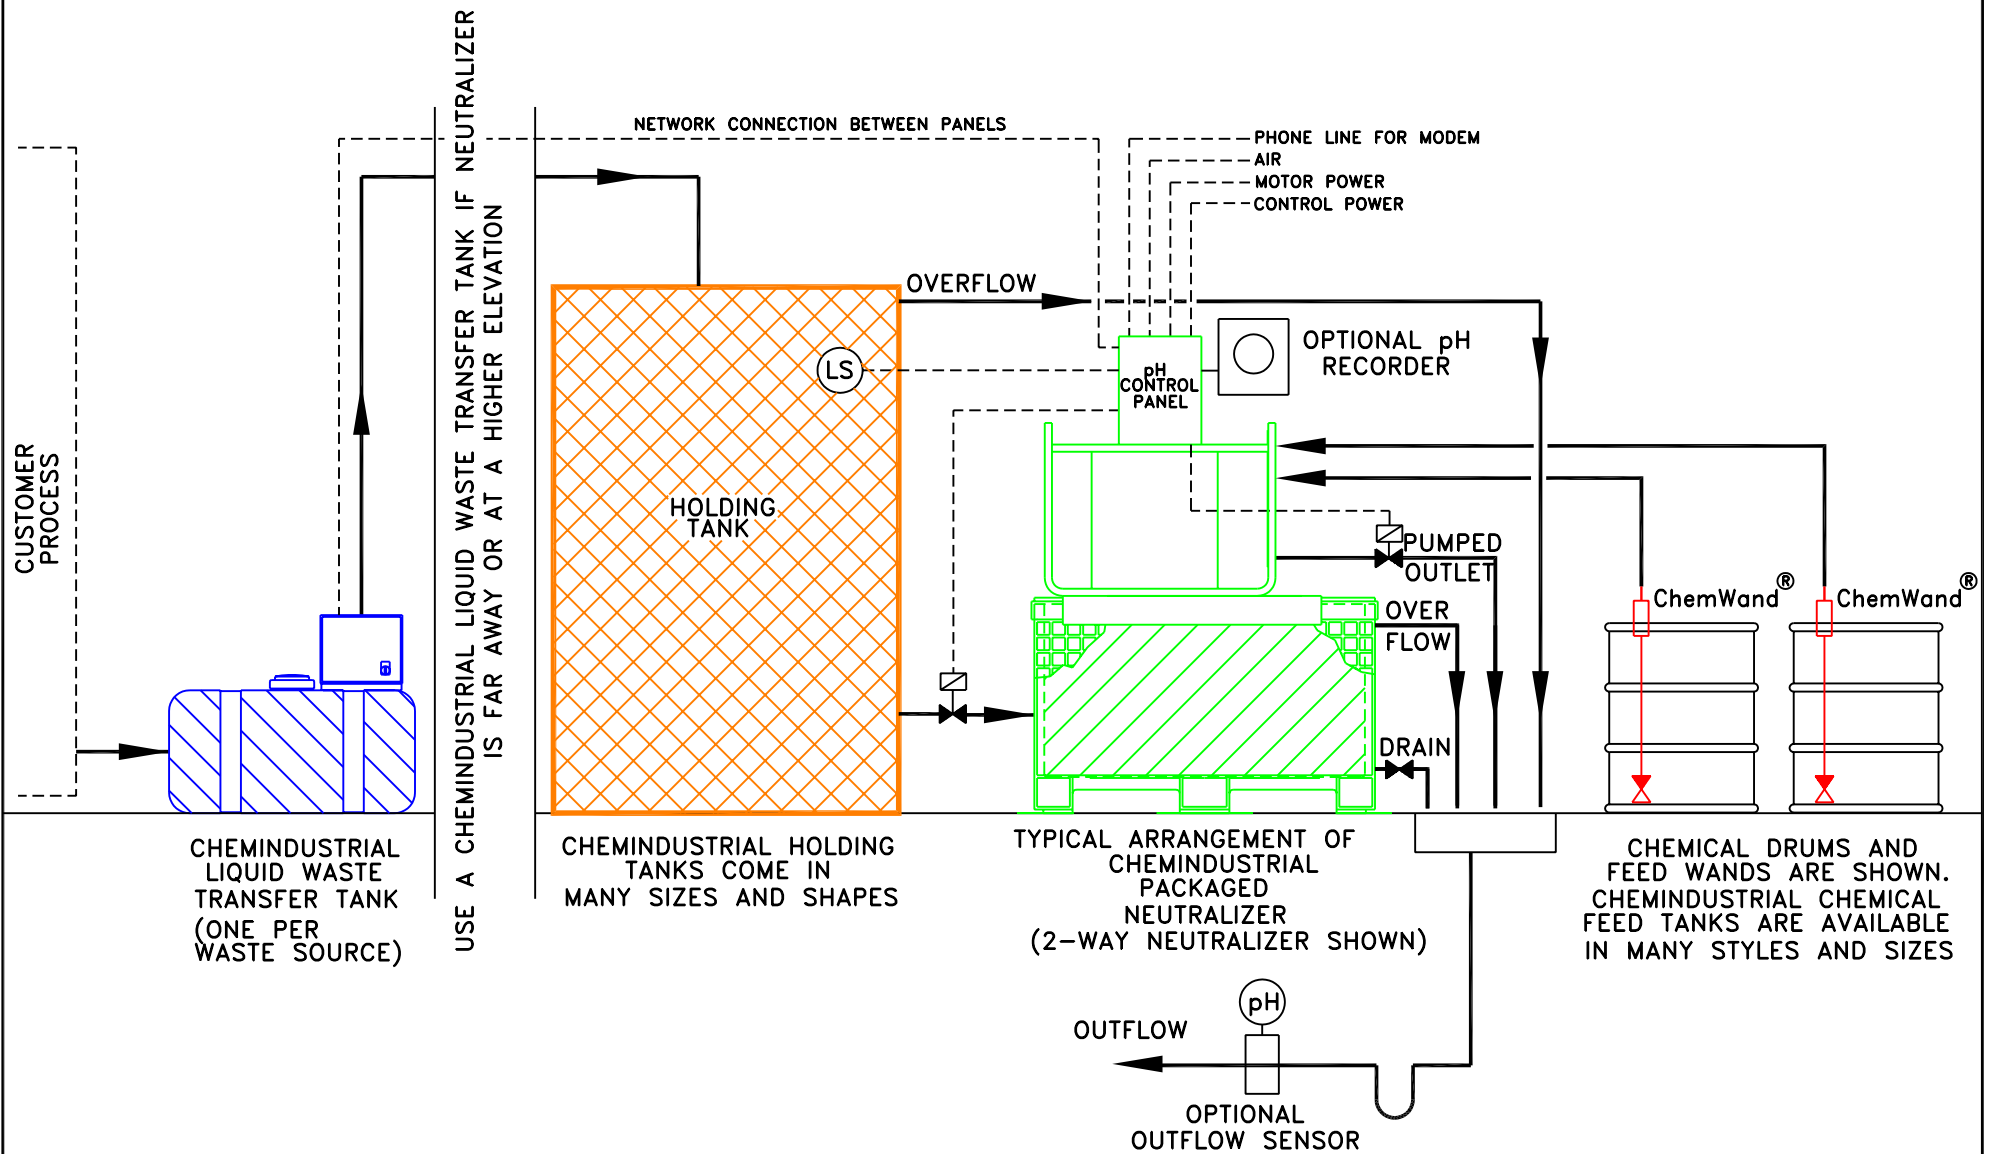

TYPICAL ARRANGEMENT #2 OF CHEMINDUSTRIAL NEUTRALIZER V01R02.DWG

 CHEMINDUSTRIAL SYSTEMS, INC. P. O. BOX 500, CEDARBURG, VT 53012 ■ (262) 375-8550 / FAX (262) 375-8559	DRAWN BY: <b>KAZ</b>
	ENGINEER: <b>ML</b>
	CHECKED: <b>ML</b>
	DATE: <b>6-OCT-99</b>

**TYPICAL ARRANGEMENT #2 OF CHEMINDUSTRIAL NEUTRALIZER**  
 VERSION 1 REVISION 2